






**INSTALLATIONSVEJLEDNING**  
**MONTAGEANWEISUNG**  
**INSTALLATION INSTRUCTION**  
**INSTRUCTIONS D'INSTALLATION**  
**INSTALLATIE INSTRUCTIES**  
**ISTRUZIONI DI INSTALLAZIONE**  
**INSTRUCCIONES DE INSTALACIÓN**



**damixa**

**FM Mattsson Danmark ApS**


Hvidkærvej 48, 5250 Odense SV  
 Abildager 26a, 2605 Brøndby  
 Tlf. +45 88 33 00 34  
 damixa-international@fmm-mora.com  
 www.damixa.com

Rev. 001  
 05/01/2024  
 2033200

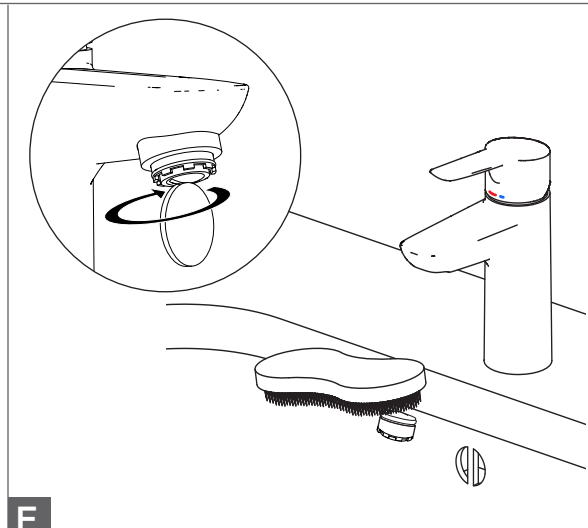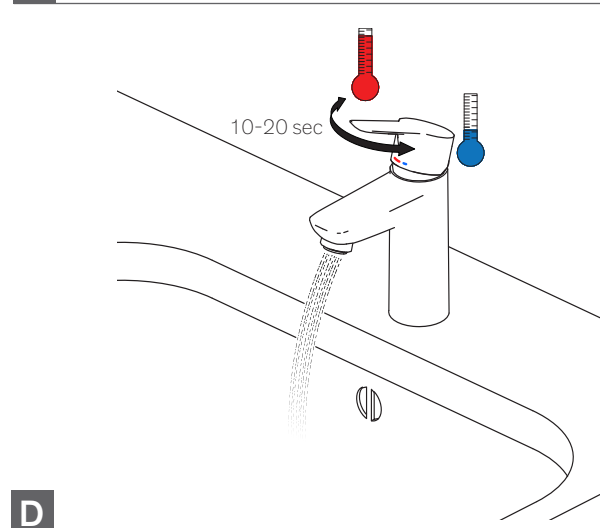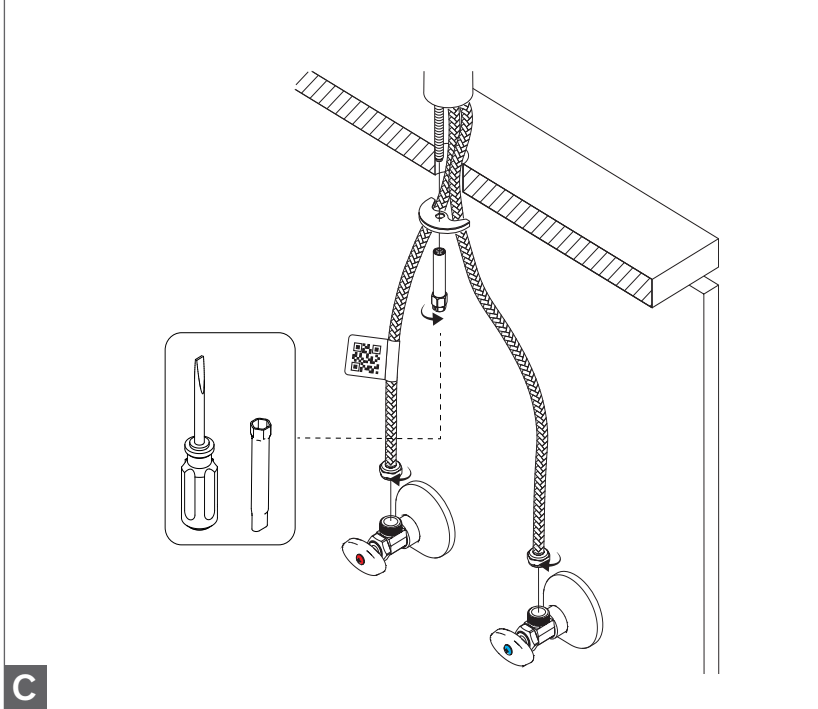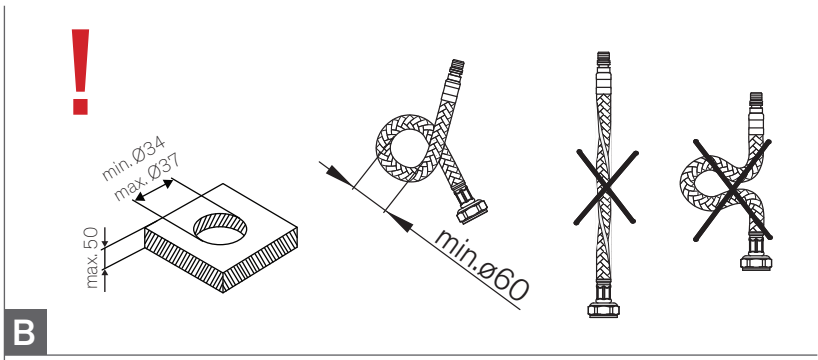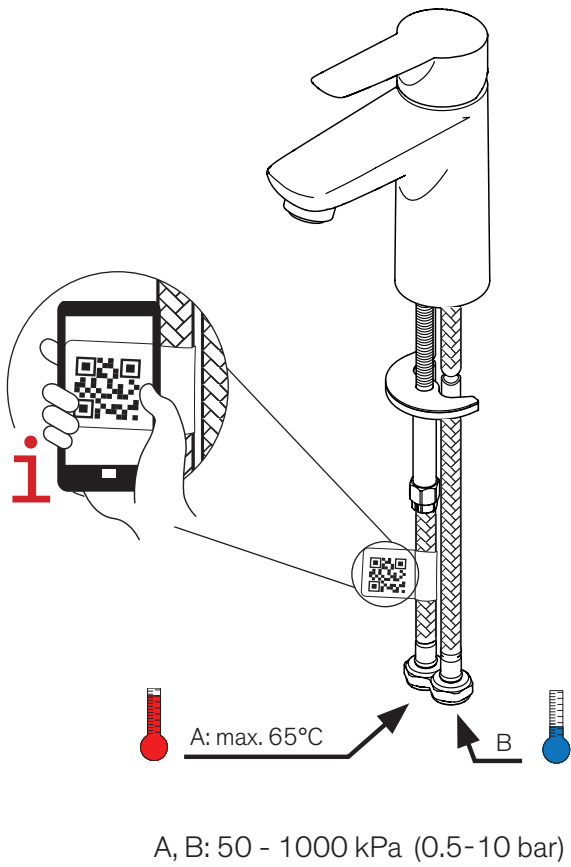


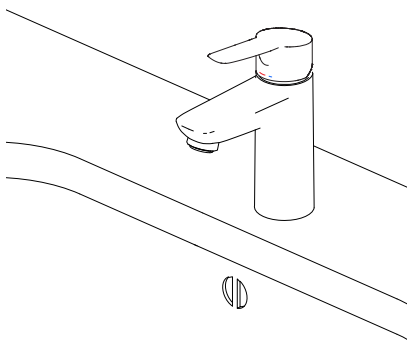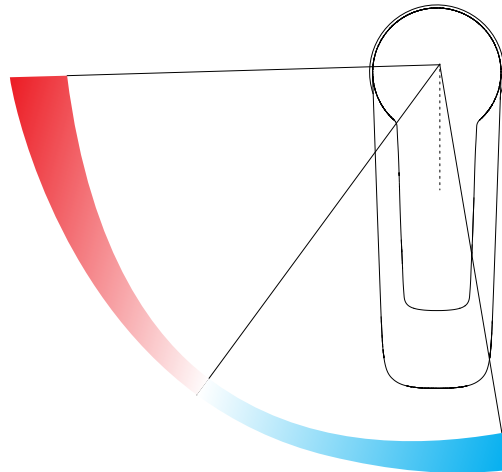

Closed


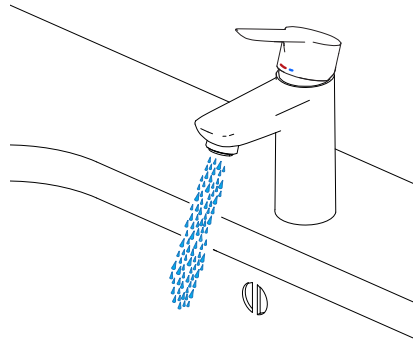


Open cold

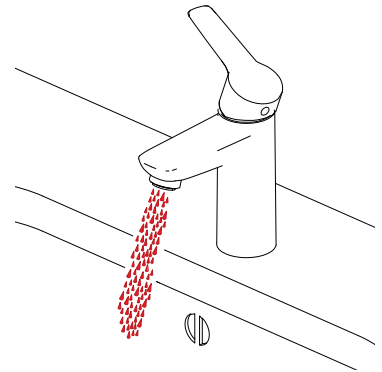


Open hot

Bottom Vaule | Bundventil | Bottenventil

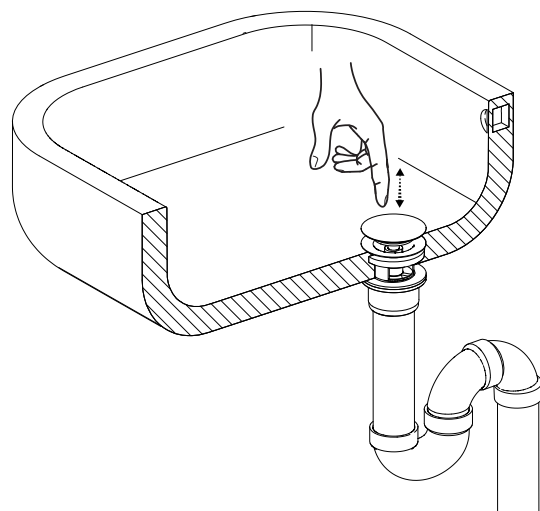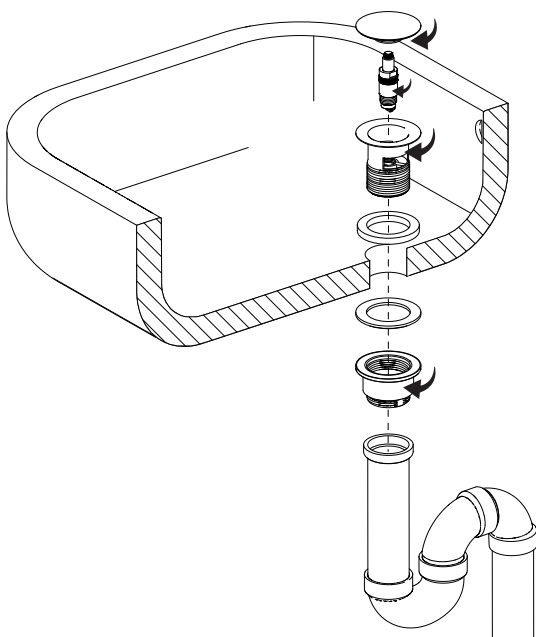

# Temperature-limiter | Temperaturbegrænser | Temperaturbegränsning

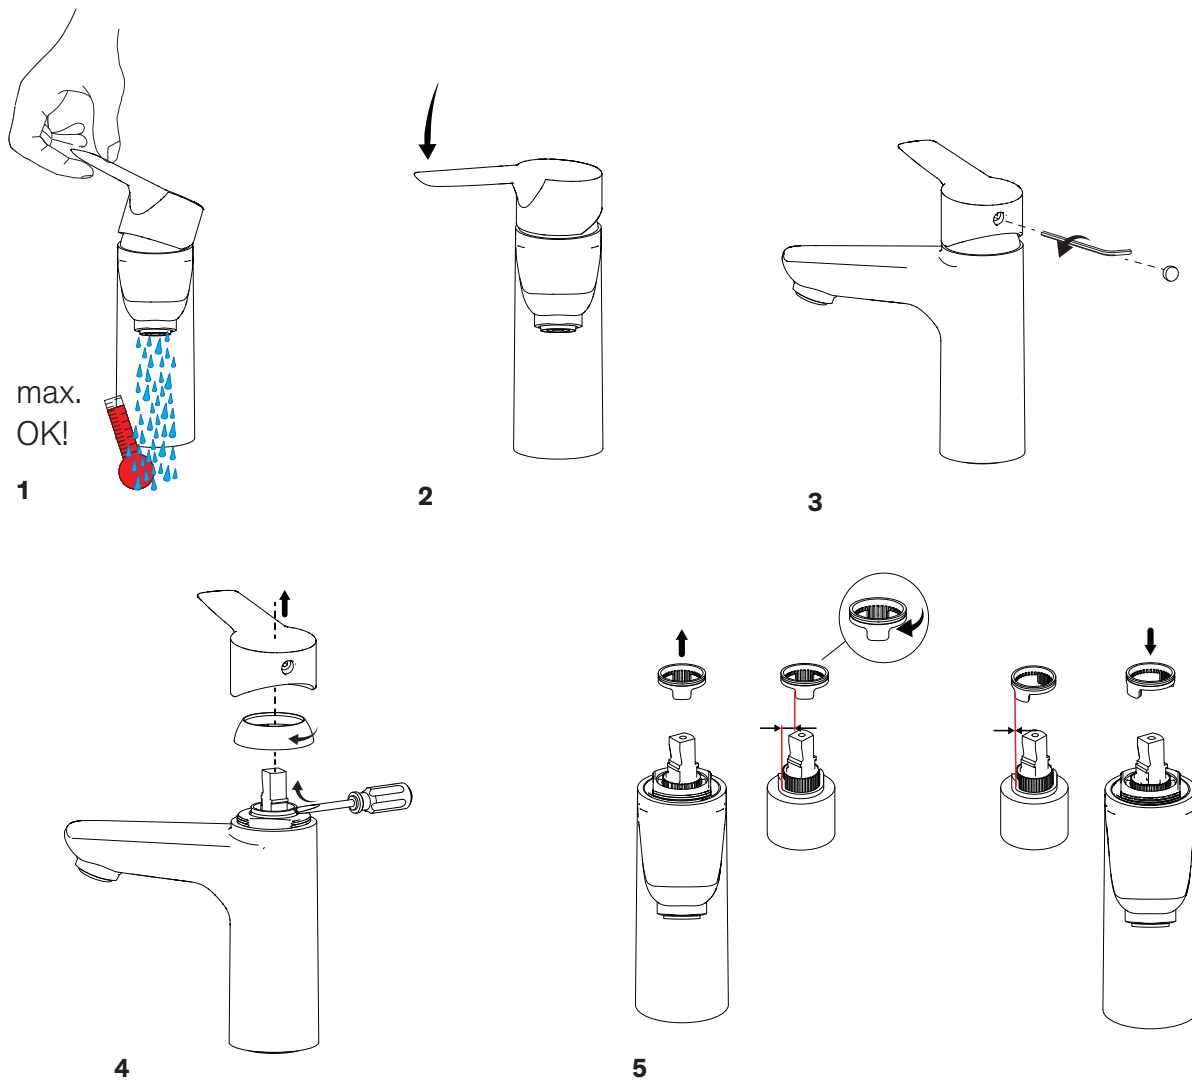

# Flow Limiter | Flowbegrænser

